



## INSTALLATION INSTRUCTIONS

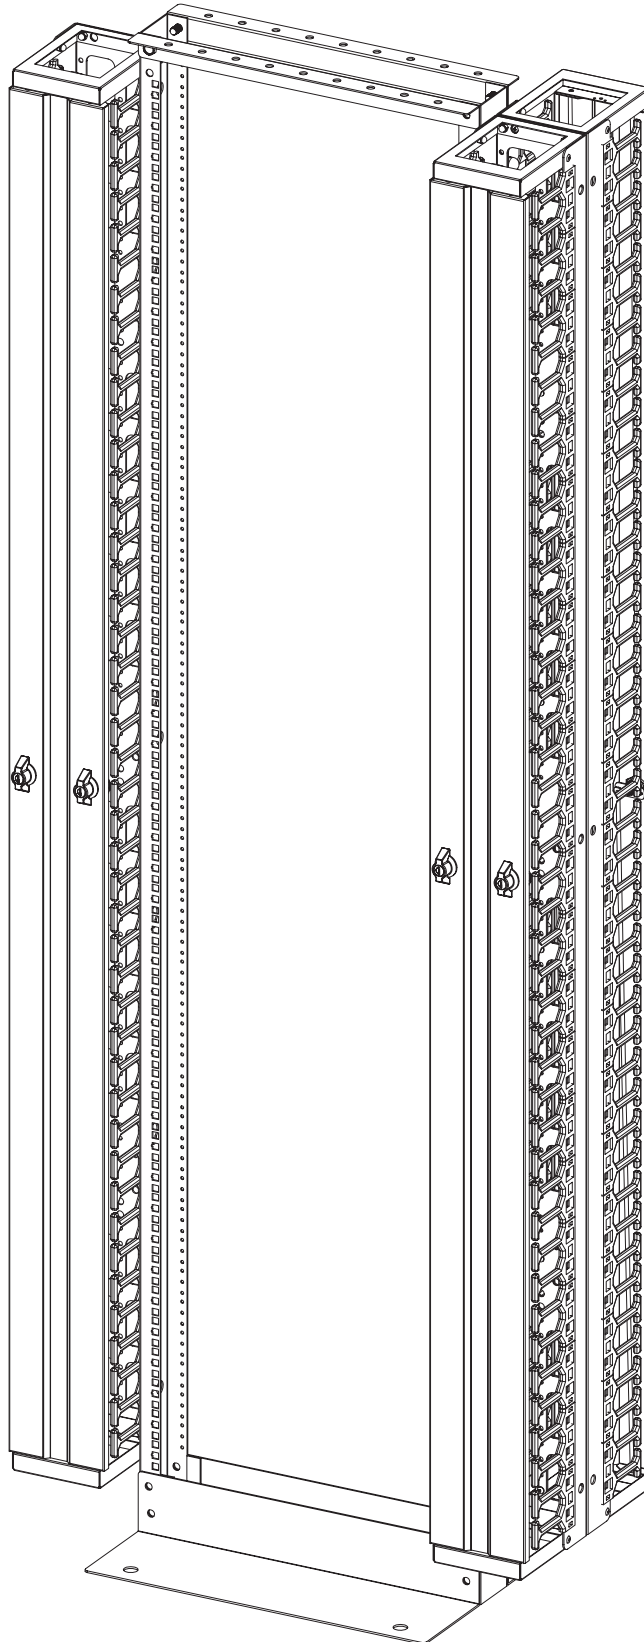


## VIADUCT CABLE MANAGER TO A 2-POST RACK

## Supplied Hardware




M10 Bolt  
& Cap Nut




M5 Screw  
& Cap Nut


## Required for Installation




Phillips Head  
Screwdriver



Socket Wrench w/  
8mm & 19mm Sockets




or 8mm & 19mm  
Box Wrenches




or Crescent  
Wrench

## STEP 1 - Single Cable Manager

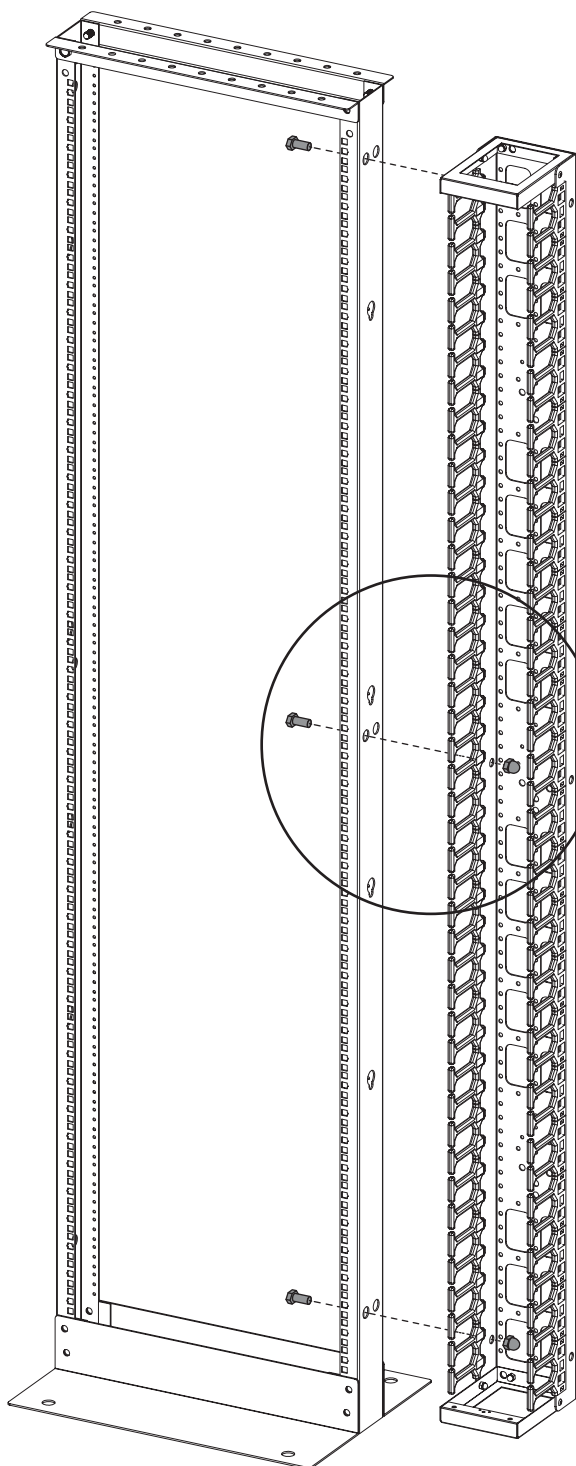


1. Remove the door from the cable manager by turning both handles.
2. Insert the (3) M10 bolts through the rack and into the cable manager as shown. Secure with (3) M10 cap nuts and tighten.

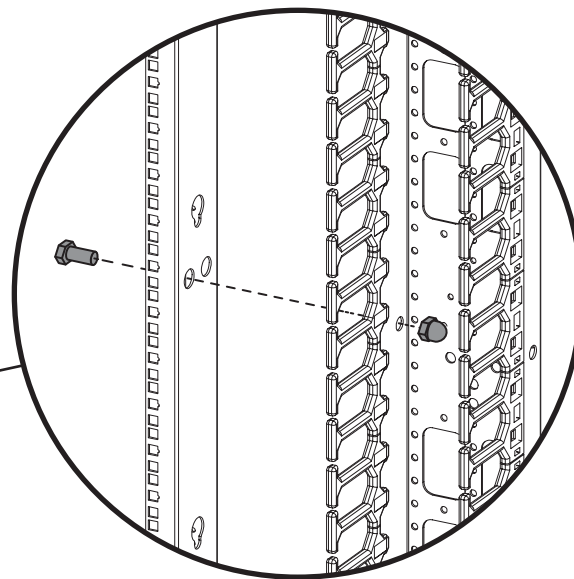


# STEP 2 - Single Cable Manager

3. Replace door on the cable manager.

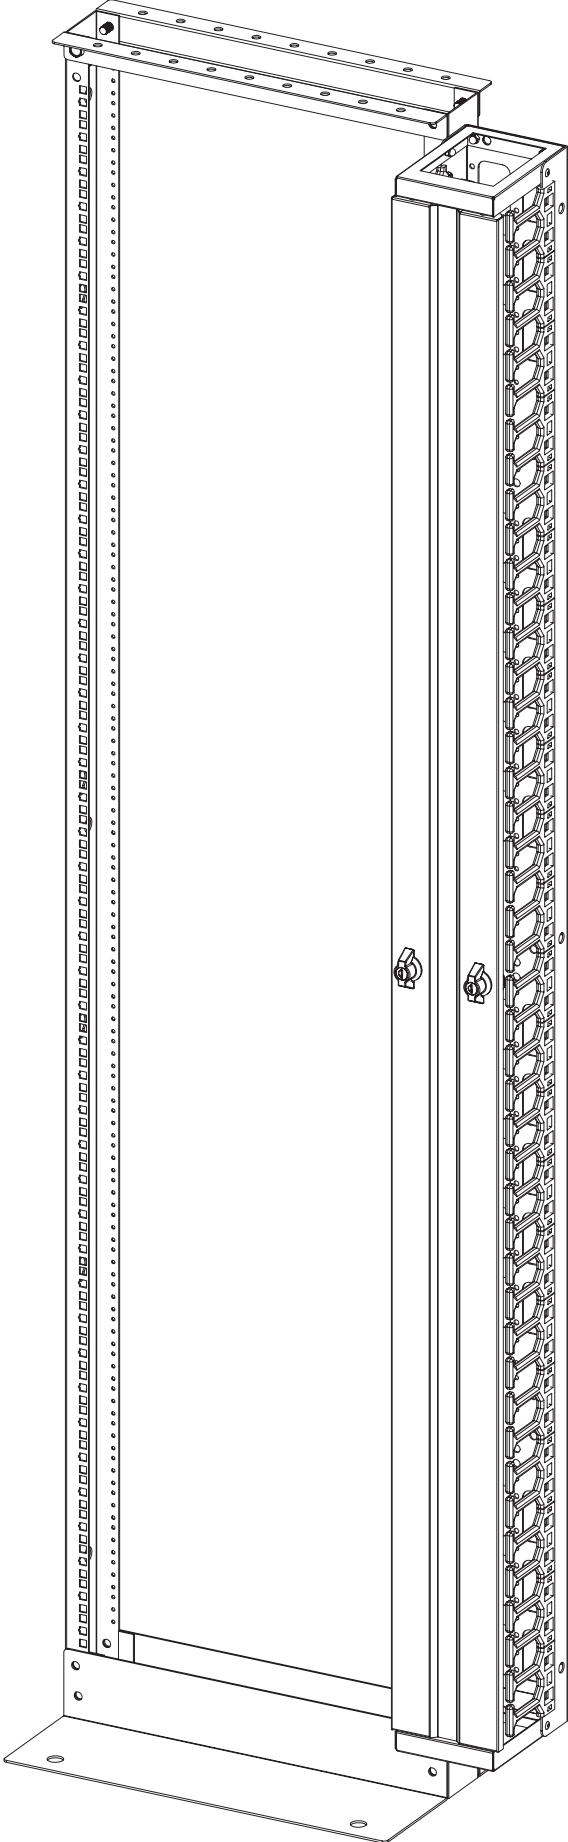


# STEP 1 - Double Cable Manager

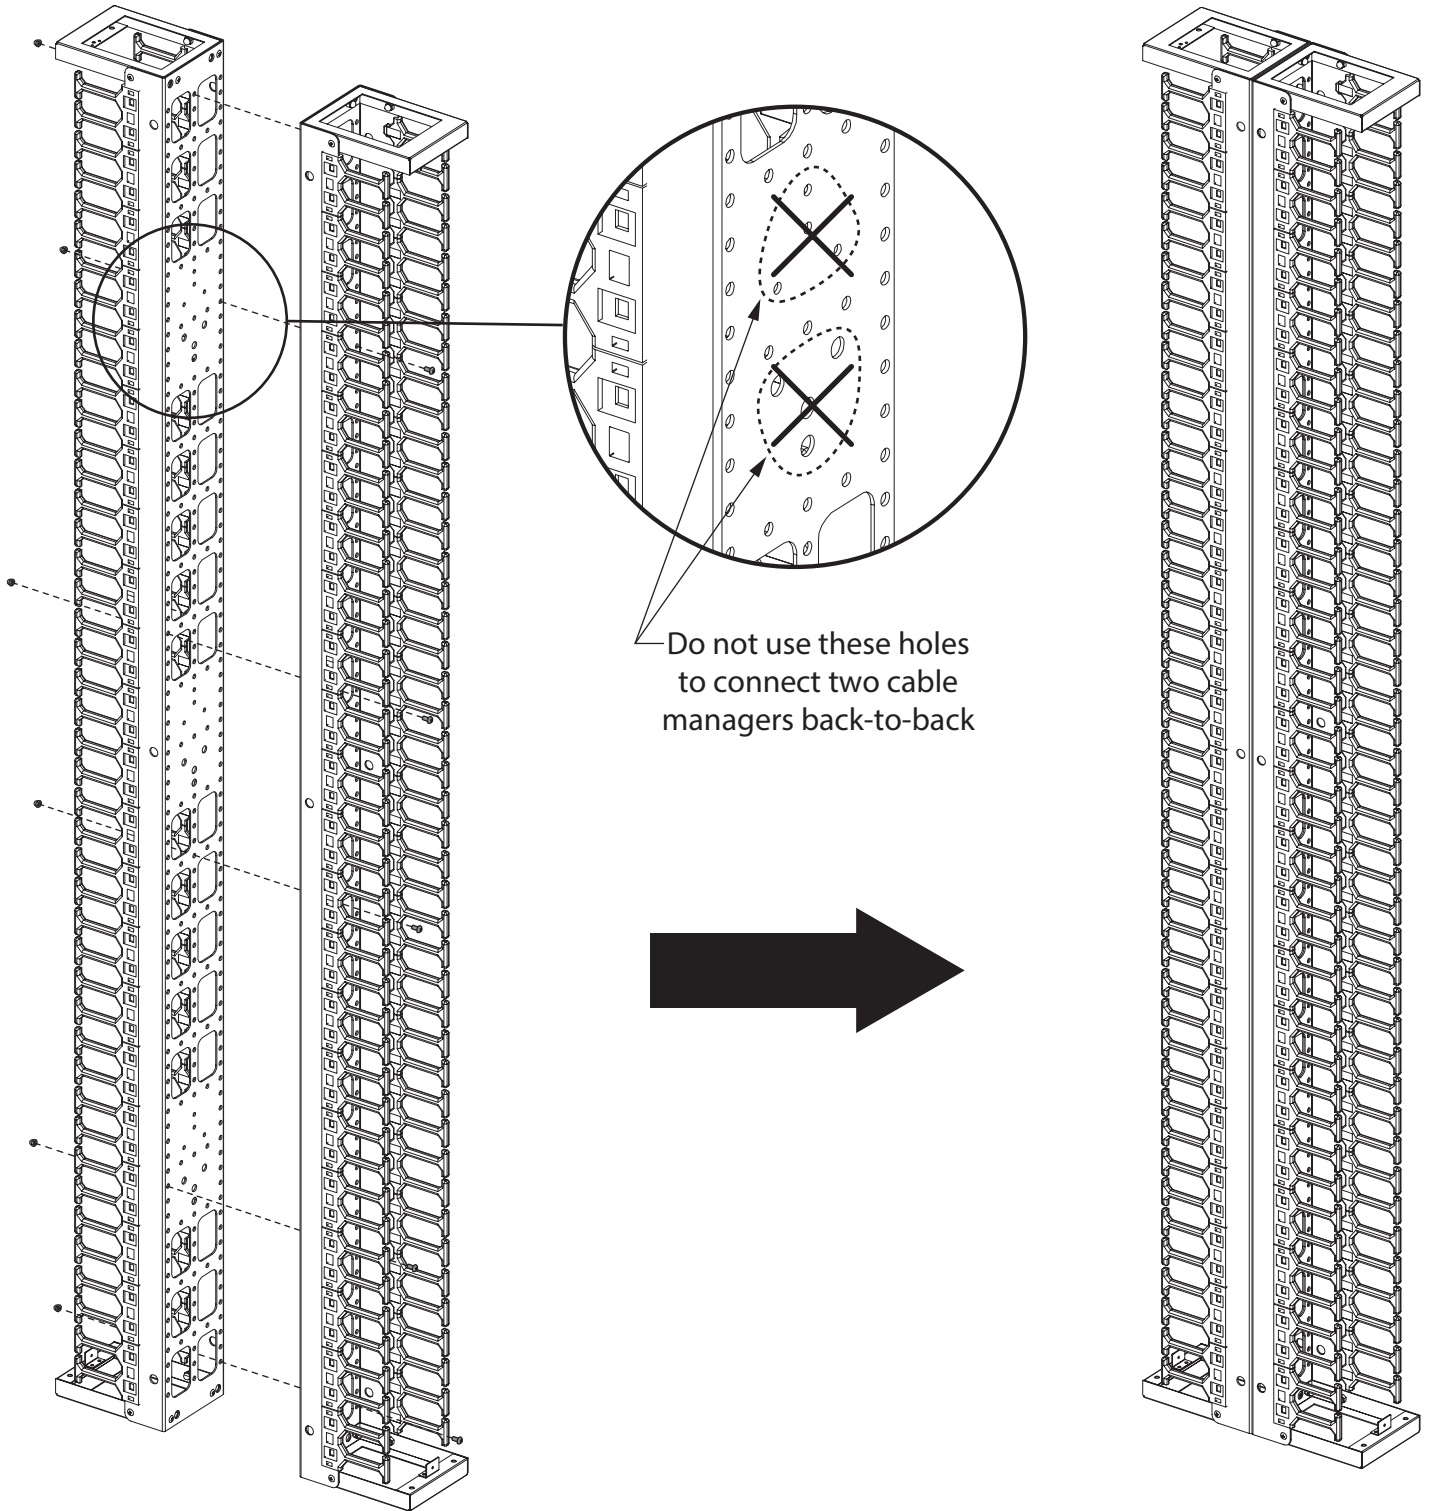

1. Position the two cable managers back to back.
2. Insert a M5 screw into any of the holes on the back of one of the cable managers, then secure using a M5 cap nut.
3. Repeat this process 5 more times, spacing out the location of the screws throughout the length and width of the cable manager.

**NOTE: do not use the holes circled in the dotted lines above.**

## STEP 2 - Double Cable Manager

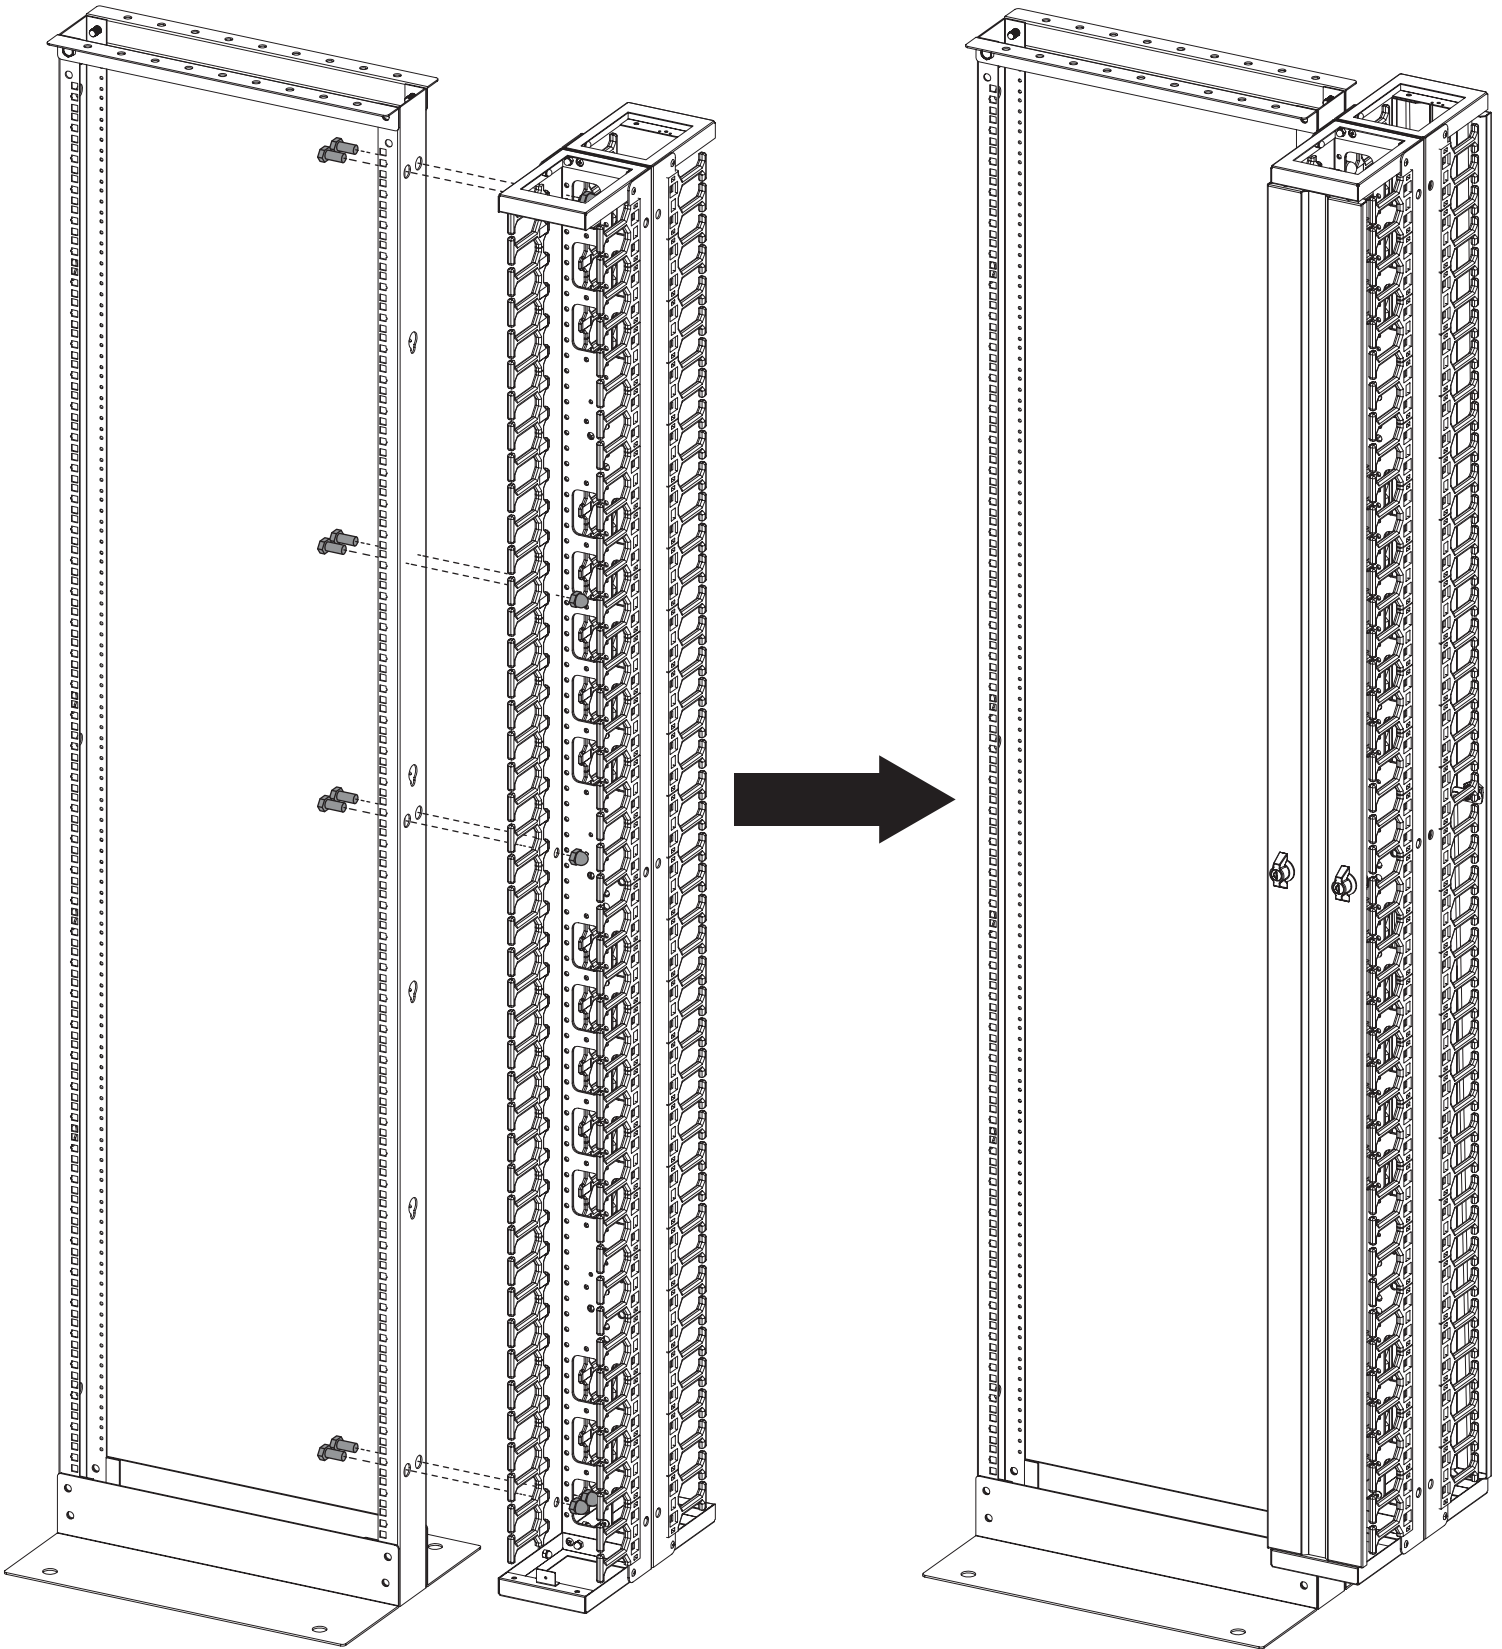

4. Insert the (6) M10 bolts through the rack and into the cable manager as shown. Secure with (6) M10 cap nuts and tighten.
5. Replace the doors on the front and back.

Use these instructions for installing the following items:

**VCM-4506S**

**VCM-4506D**

**✓ERICOM®**

2511 Wescott Blvd., Knoxville, TN 37931

vericomsolutions.com | 865.671.4455